

A "positive" for urine sugar spill does not necessarily mean a diabetic suspect. Maybe the patient's last meal was heavily loaded with carbohydrate. Many other reasons could account for this result. On the other hand a "negative" answer could mean missing a candidate for diabetes—as in an elderly patient with a high renal threshold for glucose.


Be sure — postprandially! Direct the patient to skip a meal and instead take a 7-oz. bottle of chilled GLUCOLA®, the 75-Gm. glucose loading dose that tastes like

a delicious cola beverage. One or two hours later, follow through with a blood-glucose determination with DEXTROSTIX®. Requires only a drop of fingertip or venous blood and 60 seconds of your time. A result of 175 mg. % at 1 hour or 130 mg. % at 2 hours indicates you have a diabetic suspect.

AMES COMPANY

 Division Miles Laboratories, Inc. 
Elkhart, Indiana 46514

Diabetes...true or false?

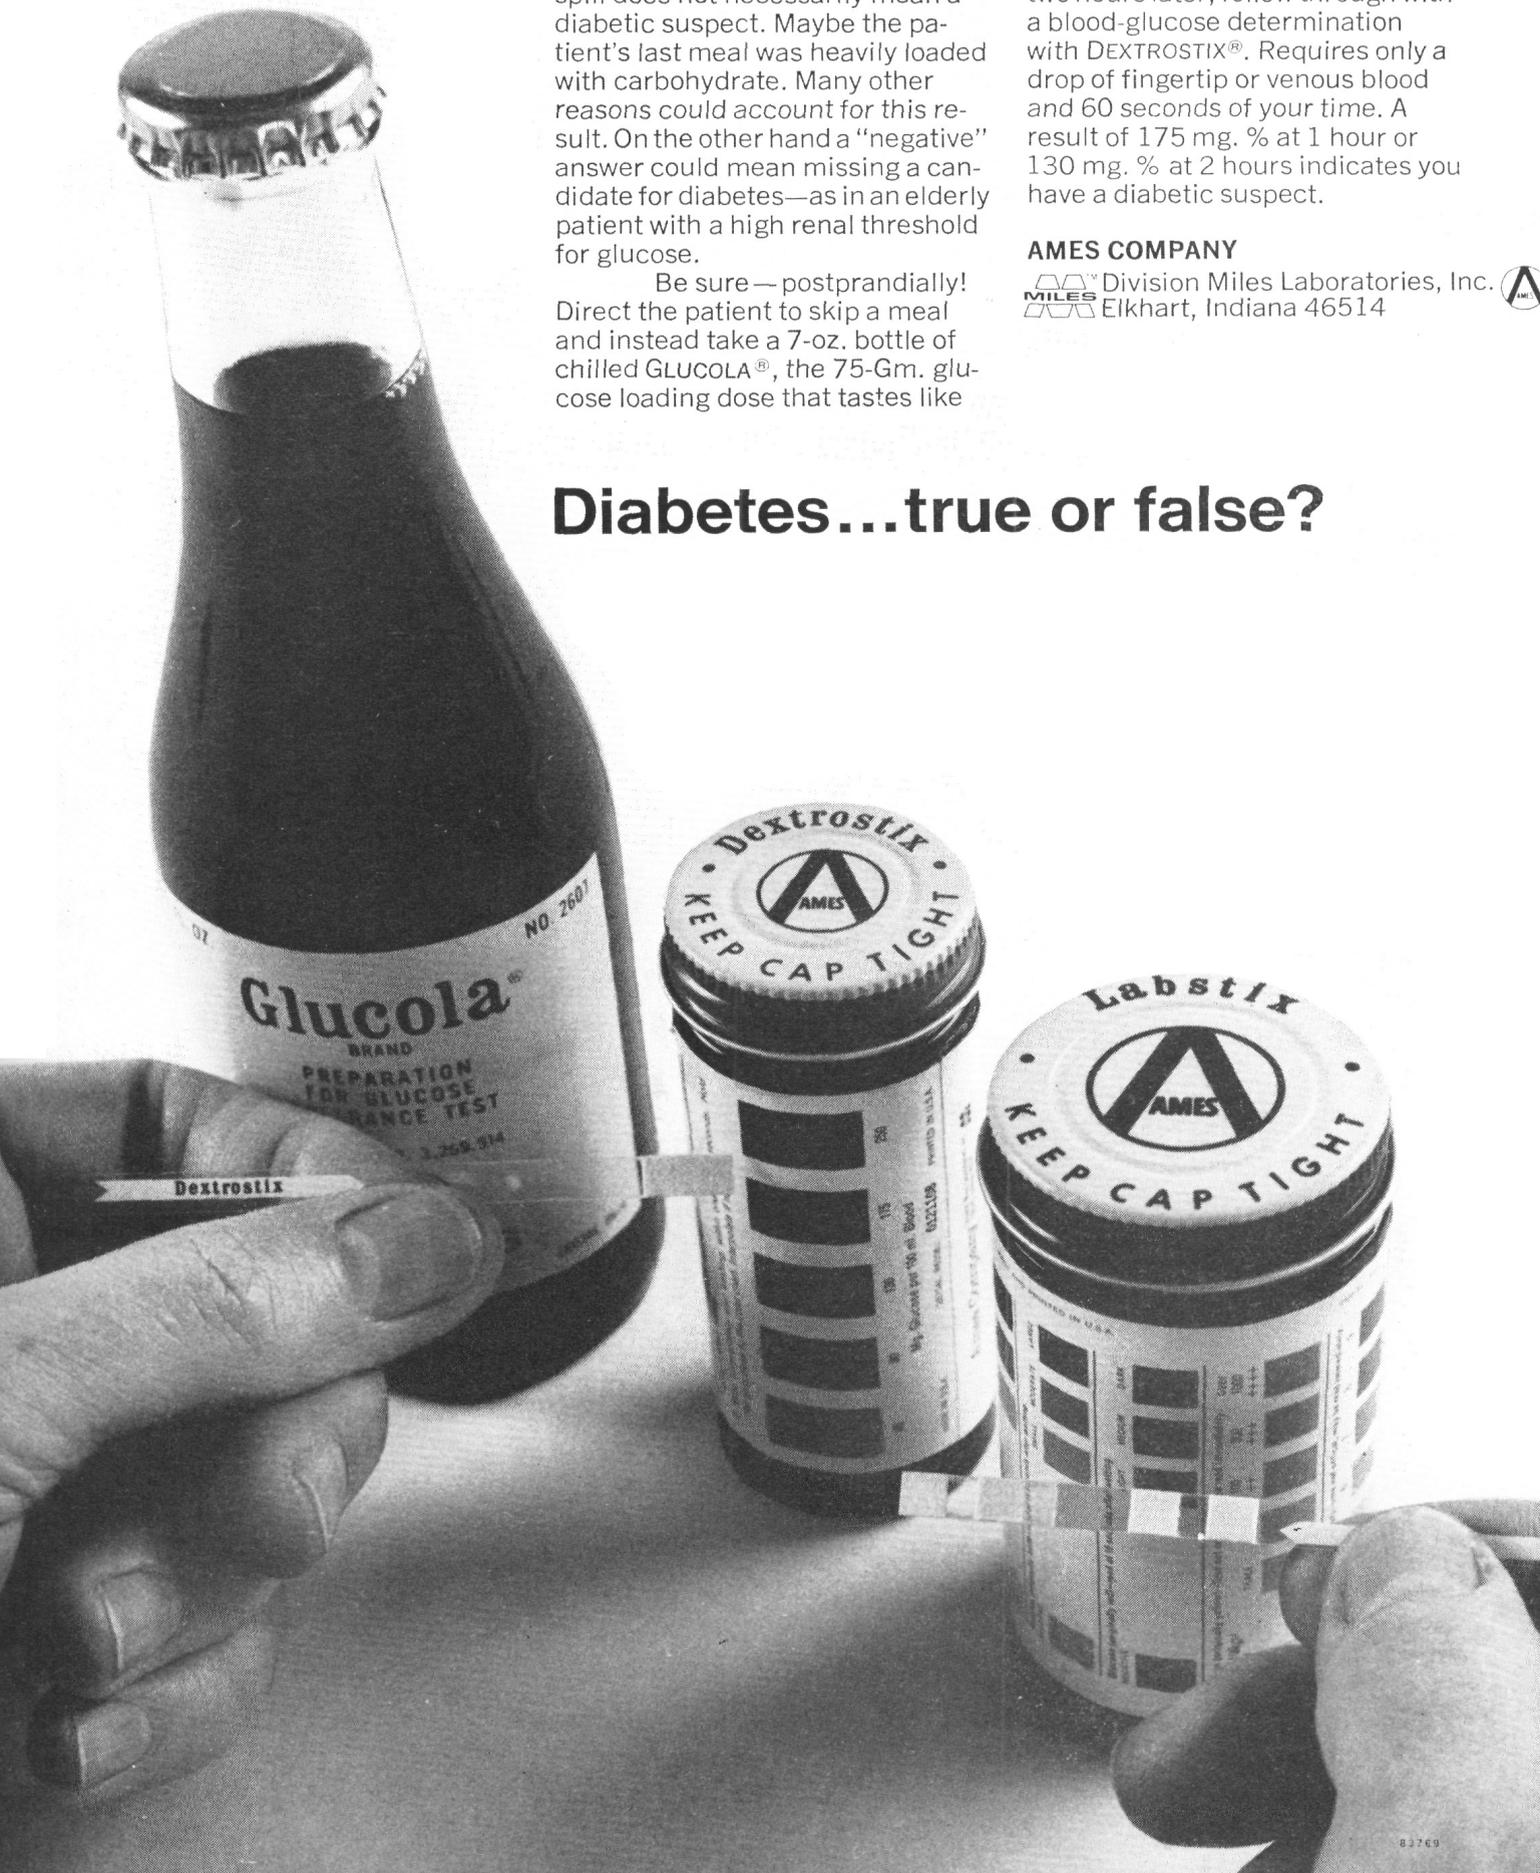


FULL 24-HOUR CONTROL

for the Majority of Diabetics

WITH

Intermediate-acting

GLOBIN INSULIN 'B. W. & CO.'[®]

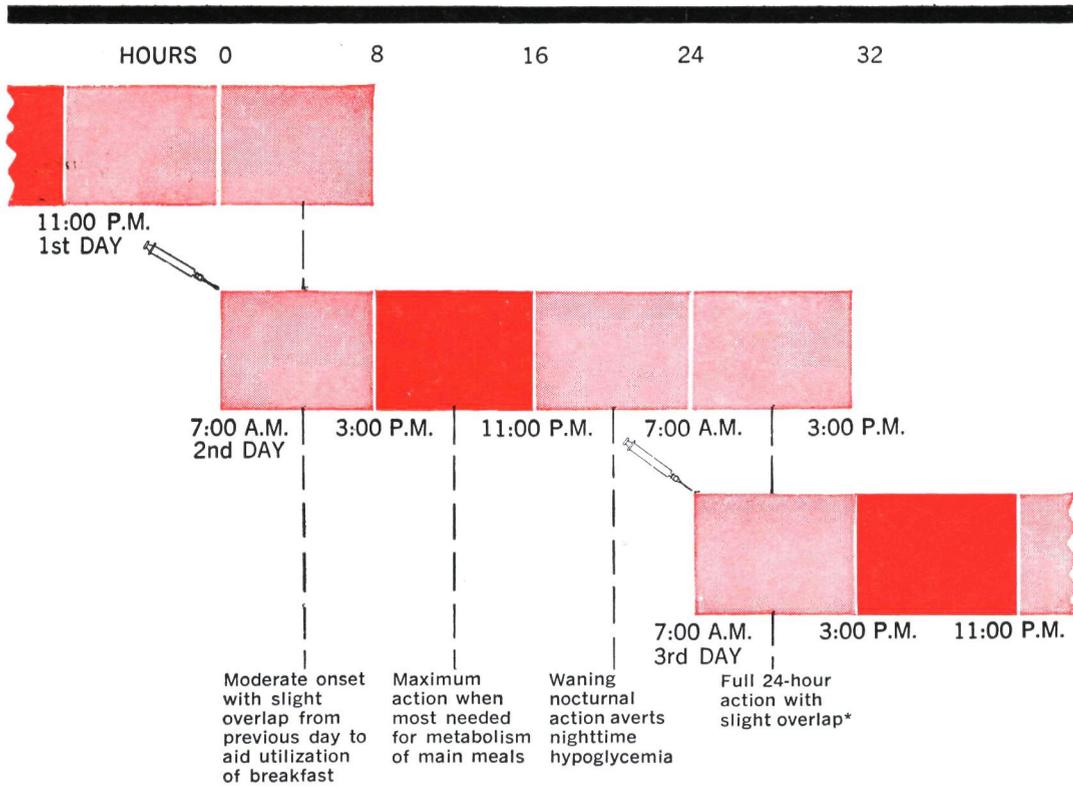

a clear solution
no shaking
or mixing required

 Duration of total action

 Duration of maximum action

*Note: Exact duration of action will vary with the size of the dose in relation to the needs of the individual patient.

Based on the exhibit "Diabetes Today and Tomorrow - The Expanding Role of the Doctor" of the American Diabetes Association displayed at the June 1958 A.M.A. Convention.



BURROUGHS WELLCOME & CO. (U.S.A.) INC., Tuckahoe, N. Y.